


A loop box will now be required on all installations utilizing a 200 A self-contained meter socket that do not require a splitter. The loop box will allow for a cable loop to provide slack when ground settling occurs in an attempt to minimize meter socket, meter socket assembly, and cable damage. Further details on the loop box requirements are contained in the section below.

Reference: SaskPower construction standards manual B-24-10 (Sheet 1) pg 29.

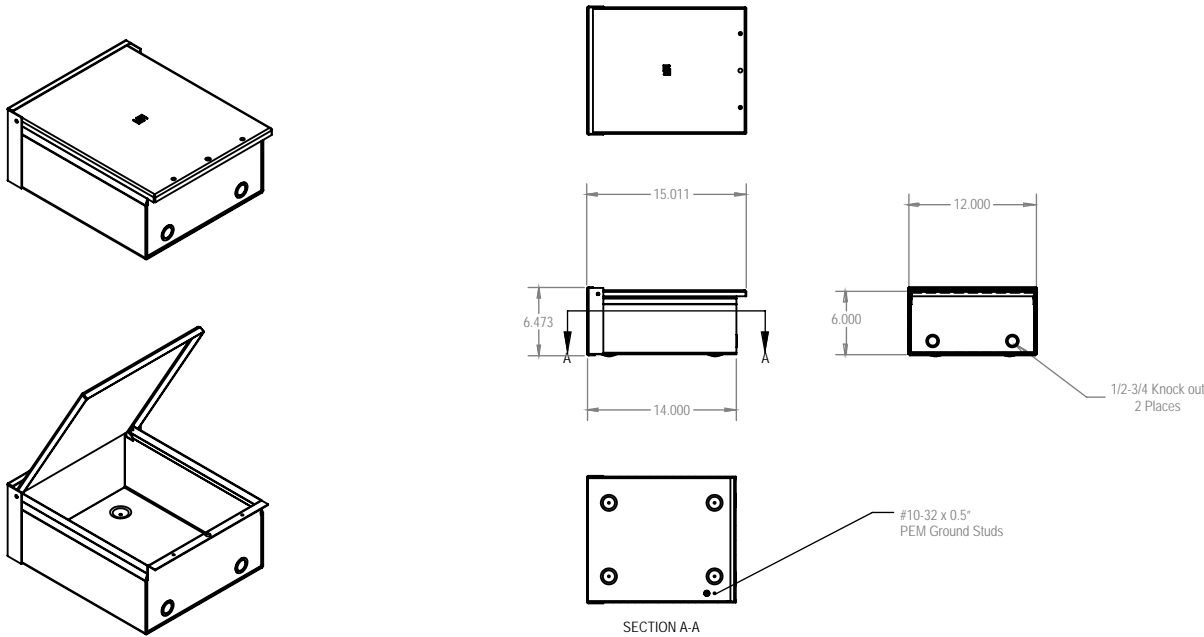

CAT No:	MAIN BREAKER	PHASE	VOLTAGE	SIZES
LP-S-141206				14 x 12 x 6

BC HYDRO / FORTIS